


# UNITS ARE FACTORY SHIPPED IN THE RS485 DATA CONFIGURATION



A SHUNT MUST BE APPLIED TO J6 WHEN THE UNIT IS IN SENSORNET/MANCHESTER MODE. SHUNT MUST BE REMOVED WHEN UNIT IS IN RS485 MODE.

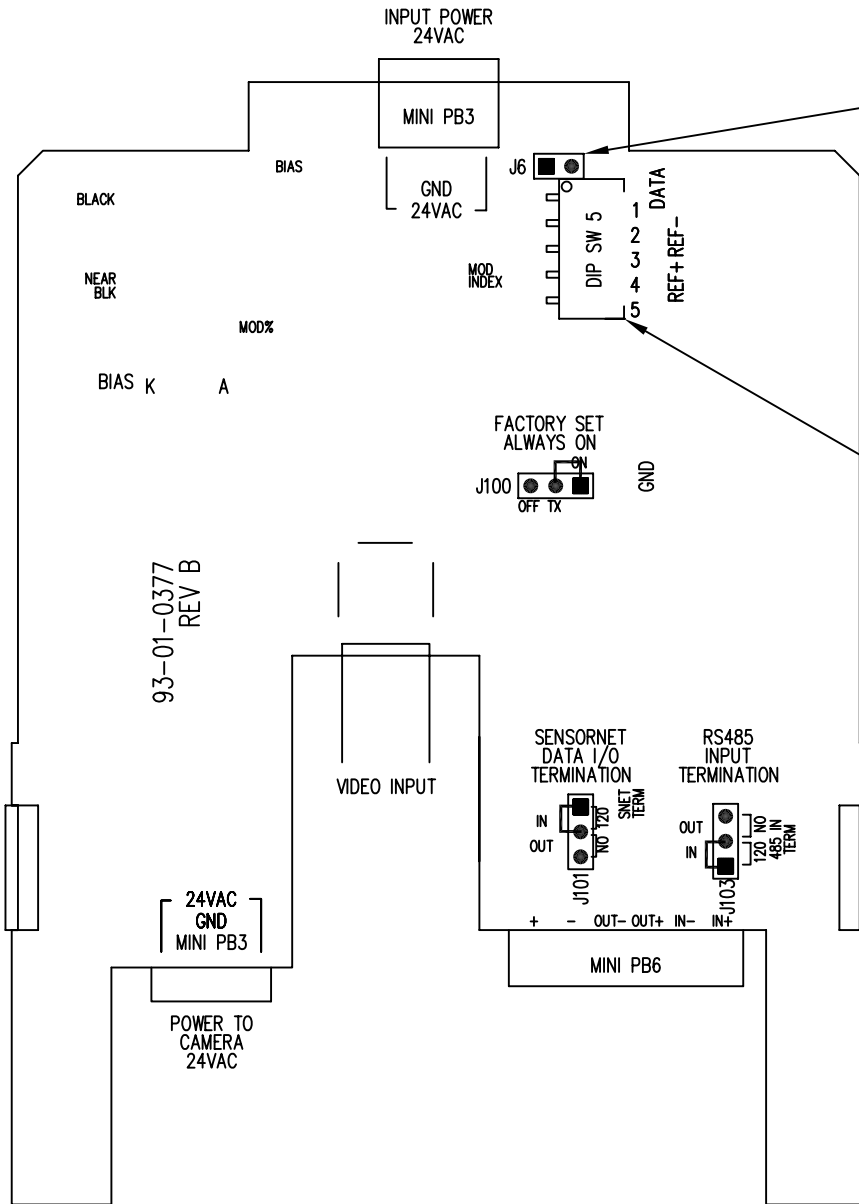

SENSORNET/  
MANCHESTER



RS485

SHUNT HANGS OFF PIN 2

SWITCH POSITION	1	2	3	4	5
SENSORNET/ MANCHESTER	UP	DOWN	DOWN	DOWN	UP
RS485	DOWN	UP	UP	UP	DOWN

DATA CONNECTOR	
1	SENSORNET/MANCH. +
2	SENSORNET/MANCH. -
3	RS485 OUTPUT -
4	RS485 OUTPUT +
5	RS485 INPUT -
6	RS485 INPUT +

 120 BELMONT DRIVE SOMERSET N.J.	DATE:	04 FEB 08			MTM-1460 CONNECTION DRAWING		
	ACAD FN.:	MTM-1460 CC					
	SCALE:	1.25:1	DWG BY:	BLB	DWG. NO.:	SH. OF	REV.: